




Energy consumption comparison

Estimated energy consumption vs. Operating costs

■ KW/Hrs
■ Annual energy cost

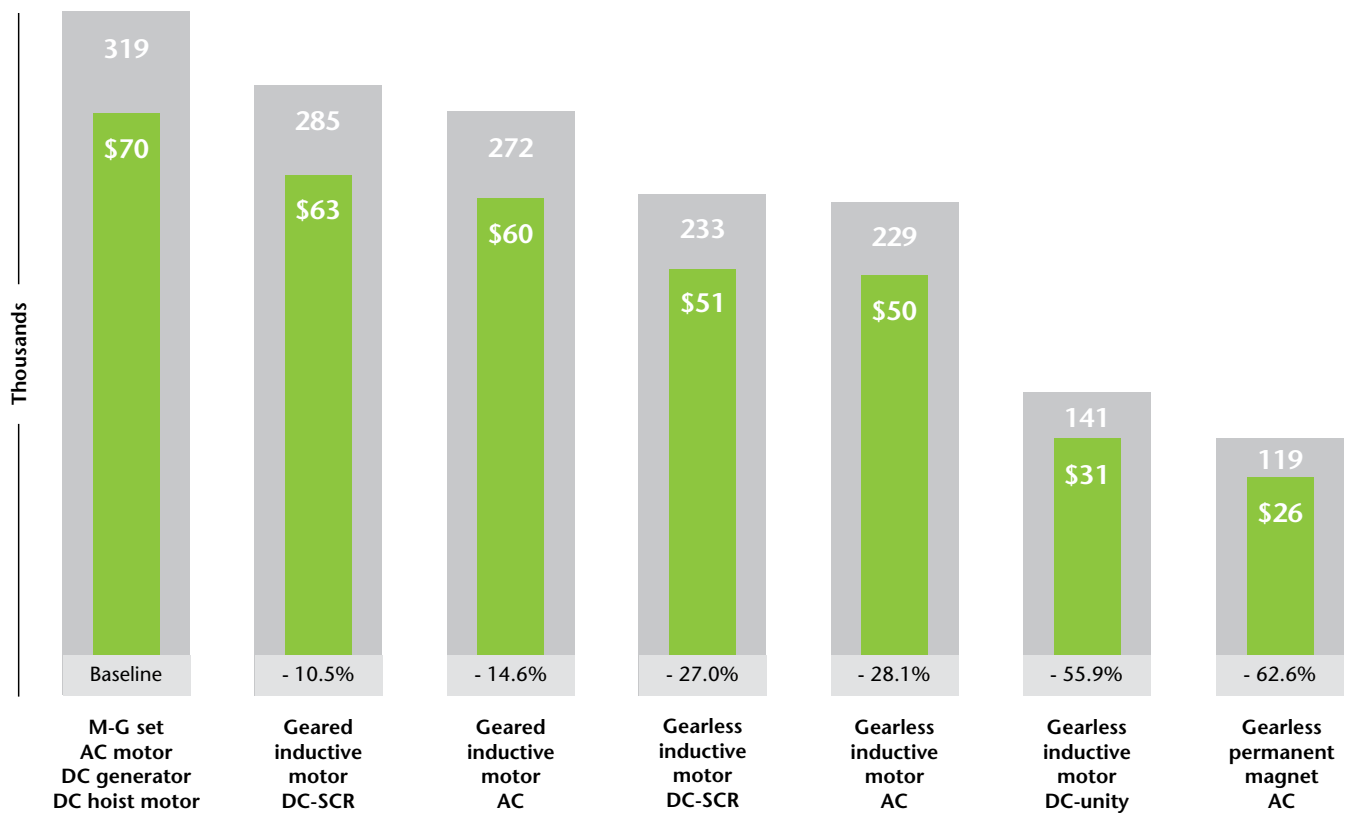

Customer name and location:

Queens Medical Center, Honolulu HI

Data compared:

Estimated energy consumption vs. Operating costs for elevator hoisting technologies

Data shown represents seven (7) elevators in a defined application for which the customer requested a comparison of available hoisting technologies.

Disclaimer: Measured or calculated values are based on a model elevator. The values may vary depending on individual installations. KONE does not accept any liability for possible differences between the individual installation and KONE measured or calculated model.

